


Power Module

The Power Module family is a group of modular products for the control of lighting loads. This document describes the following products:


- Model Number: LQSE-4S10-D - Power Module unit for Switching only
- Model Number: LQSE-4T10-D - Power Module unit for 0-10 V/Switching

Features

- Includes QS link for seamless connection to a HomeWorks® QS system.
- Power Module units can be used in a HomeWorks® QS system to control and manage light in an entire home or building.

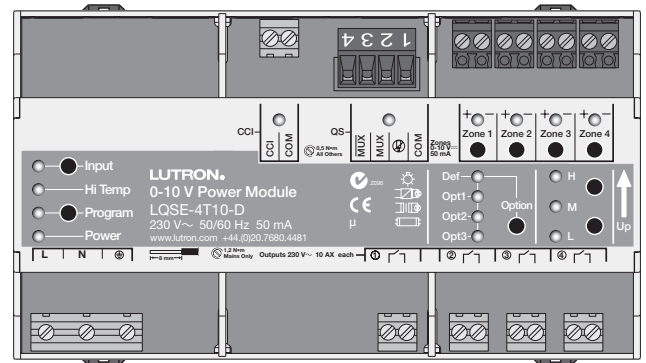


LQSE-4T10-D

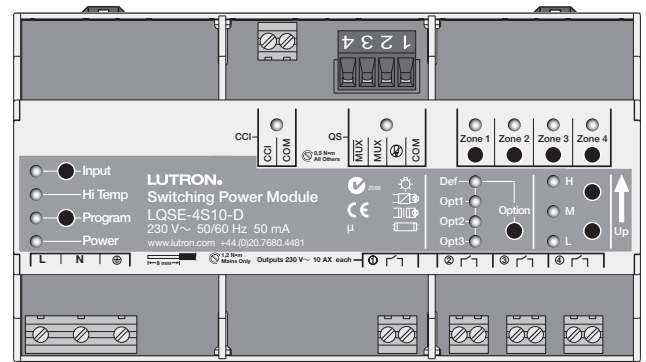

LQSE-4S10-D

System Example

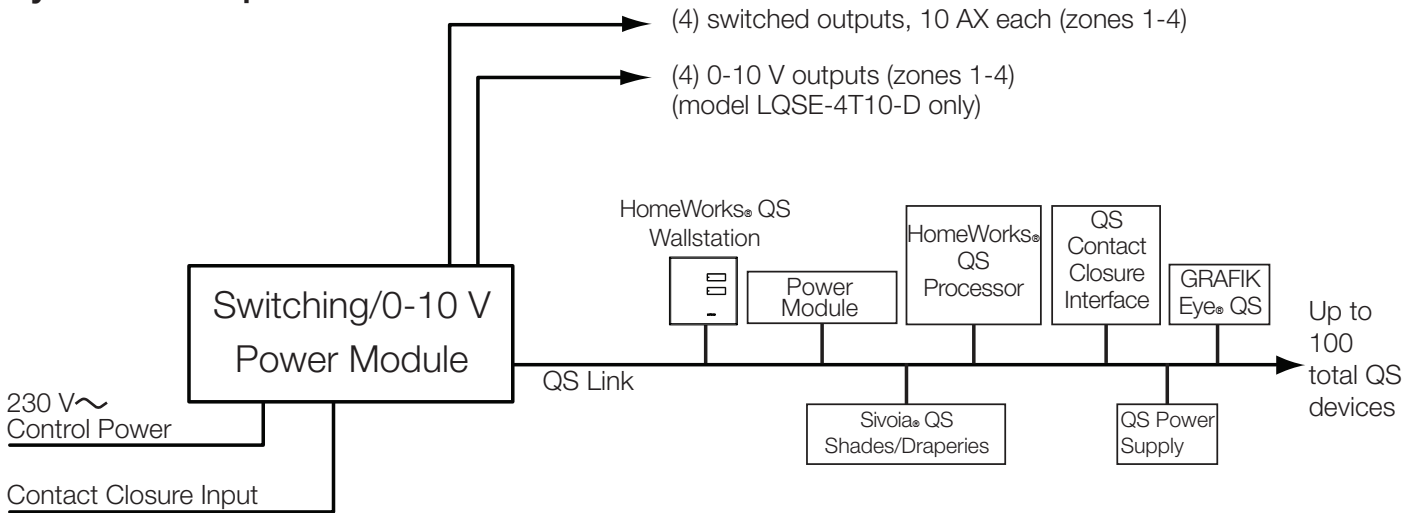

Job Name:	Model Numbers:
Job Number:	

Specifications


Power

- 230 V \sim 50/60 Hz
- Lightning strike protection meets ANSI/IEEE standard 62.31-1980. Can withstand voltage surges of up to 6 000 V \sim and current surges of up to 3 000 A.
- Current draw: 50 mA max
- Standby power : 1 W
- BTUs/hour when fully loaded: 4

Output Zone Ratings

- Each zone is rated at 10 AX for switching. Rated for resistive, capacitive, or inductive lighting loads as defined by IEC/EN 60669-2-1.
- Switched outputs utilize latching relays to maintain relay state if control power is lost.
- 0-10 V rated for 50 mA maximum output, source or sink per zone.

Standards

- IEC/EN 60669-2-1, EN50428
- Lutron Quality Systems registered to ISO 9001:2008
- CE
- C-Tick 

Environment

- Ambient Temperature Operating Range (inside mounting panel): 0 °C to 40 °C
- Calibration point maximum: 65 °C
- Relative humidity: less than 90% non-condensing
- For indoor use only

Terminals

- Mains wiring: 0,5 mm² to 6,0 mm²
- 0-10 V Wiring: 0,5 mm² to 2,5 mm²
- CCI Wiring: 0,5 mm² to 6,0 mm²
- Zone wiring: 0,5 mm² to 6,0 mm²

Mounting

- Use an IP20 (minimum) rated consumer panel or breaker panel with integrated DIN rail
- Width = 9 modules (161,7 mm)

Programming and Compatibility Requirements

- LQSE-4T10-D and LQSE-4S10-D can only be used with the HomeWorks[®] QS system.
- Setup and programming of the DALI[®] Power Module is done through the HomeWorks[®] QS programming software.
- HomeWorks[®] QS software version 3,0 or higher required.

HomeWorks[®] QS Wallstations

- HomeWorks[®] QS wallstations can be configured to control Power Modules with the HomeWorks[®] QS programming utility.
- LED indicator displays the status of programmed lights.

QS Link Limits

- A QS link in a HomeWorks[®] QS system can have up to 512 zones (outputs) and 100 devices.
- Each Power Module counts as one device toward the 100 device limit.

Manual Mode Operation

- Zone buttons:
 - selects zone to control
- Raise/Lower buttons:
 - turns loads on and off
 - dim loads up and down (LQSE-4T10-D only)

NOTE: Program, Input, and Option buttons are not used in LQSE models.


Contact Closure Input (CCI)

- The CCI behaves as a Manual Override Closure Input.
- If the CCI is open, the Power Module unit will enter Manual Override Mode, which will turn on all loads and disable control from other devices.
- When the CCI is closed or jumpered (factory default), Power Module unit zones will return to the settings or levels they were at prior to entering Manual Override Mode.


Job Name:	Model Numbers:
Job Number:	

Overview of Wiring Terminals

LQSE-4T10-D

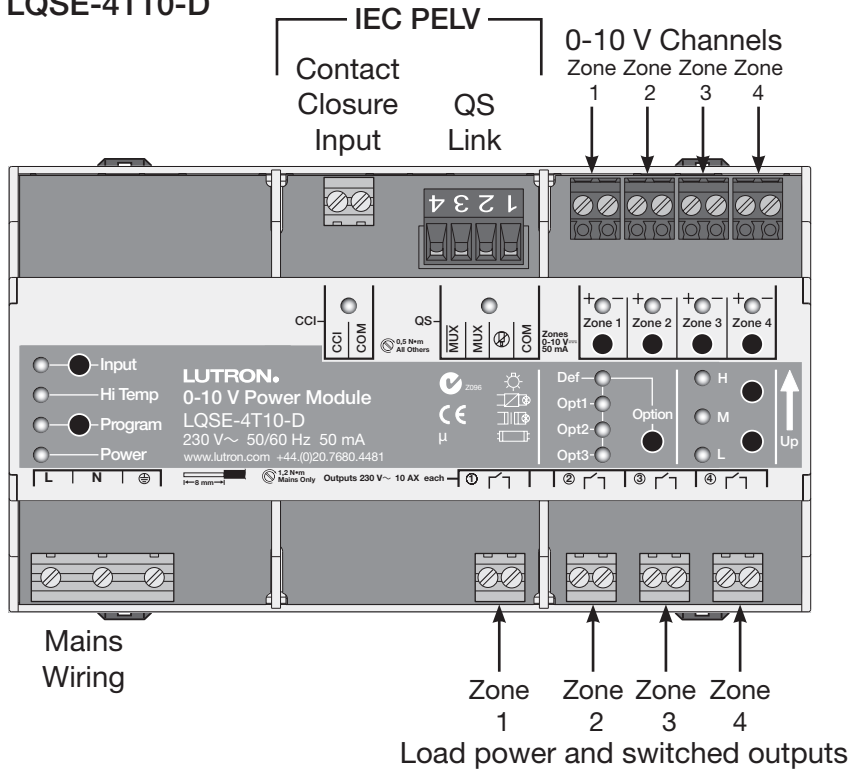


LQSE-4S10-D

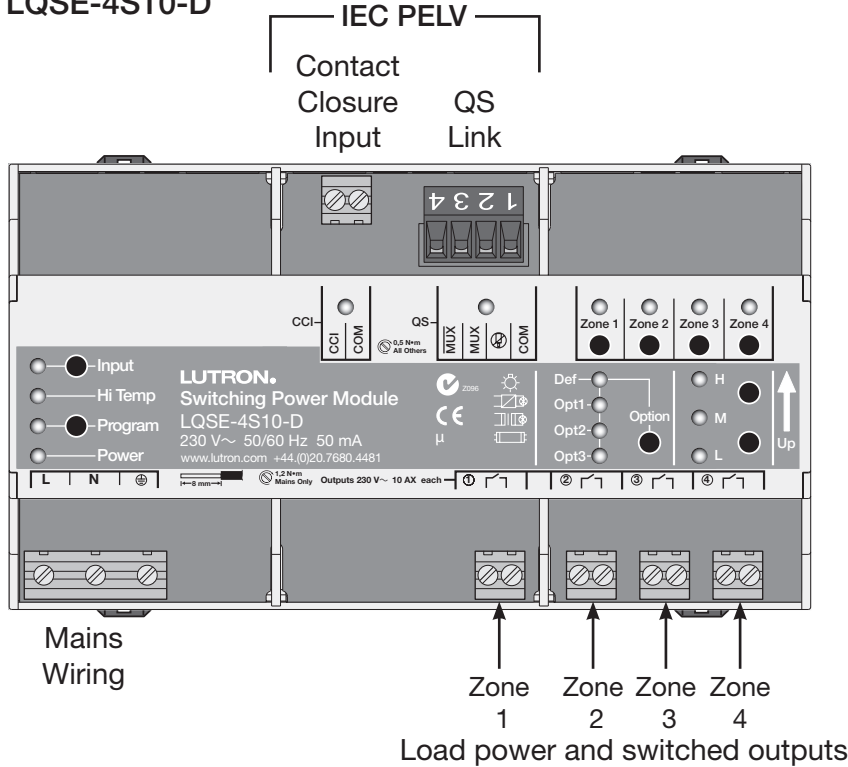



Job Name:	Model Numbers:
Job Number:	

Mechanical Dimensions

LQSE-4T10-D



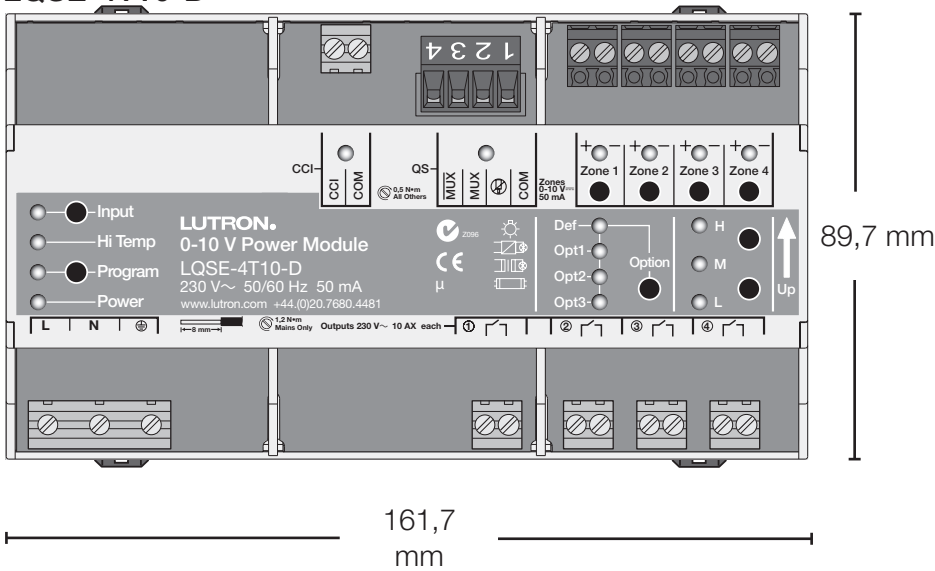


LQSE-4S10-D

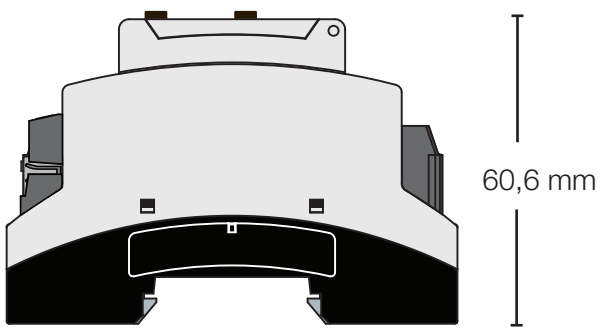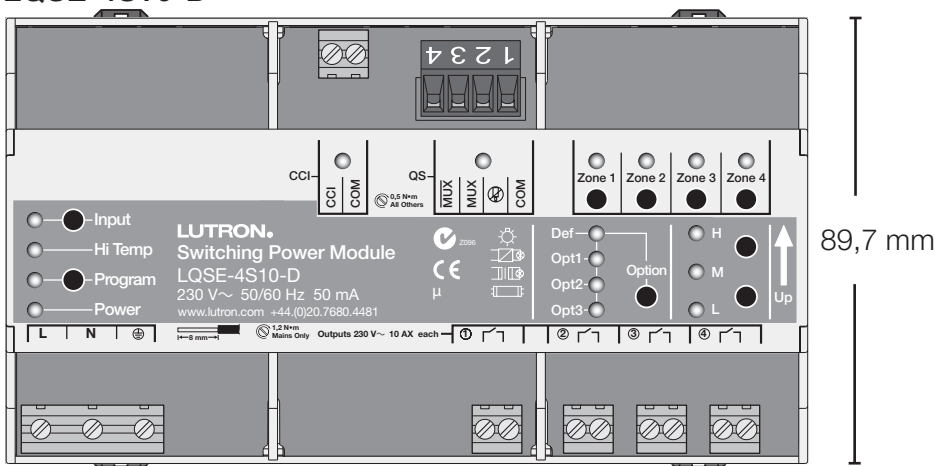


Job Name:	Model Numbers:
Job Number:	

Mains Voltage Wiring

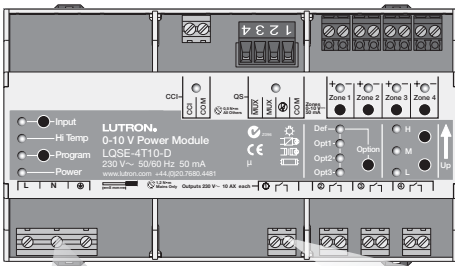

⊕ – Earth/Ground
 N – Neutral
 L – Mains/Live

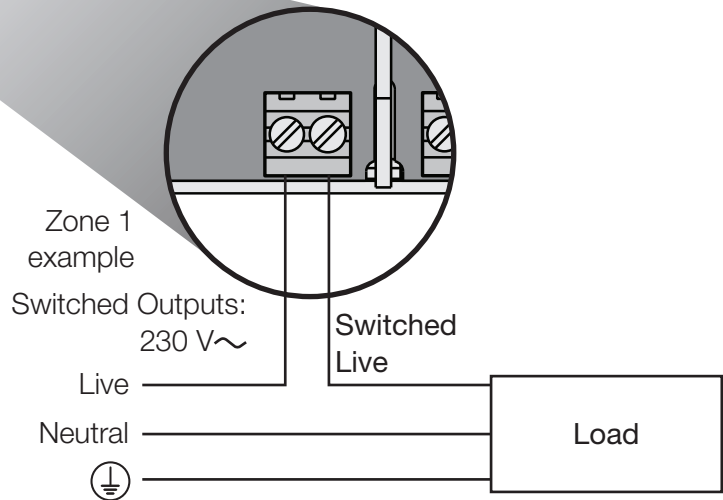

Wiring from Distribution to Power Module unit

- Turn off all circuit breakers or isolators feeding the Power Module unit at distribution panel.
- Run live, neutral, and earth (⊕) wires from a 230 V~ 50/60 Hz feed to the Power Module unit.

Mains Wiring and IEC PELV Separation


- Follow appropriate local and national codes to avoid violating required separation guidelines.

Behavior During Power Failure

- Relays do not change state when power is lost to the L/N/⊕ terminals. Follow local and national codes for emergency lighting requirements.

Job Name: Job Number:	Model Numbers:
------------------------------	----------------


Wiring: 0-10 V

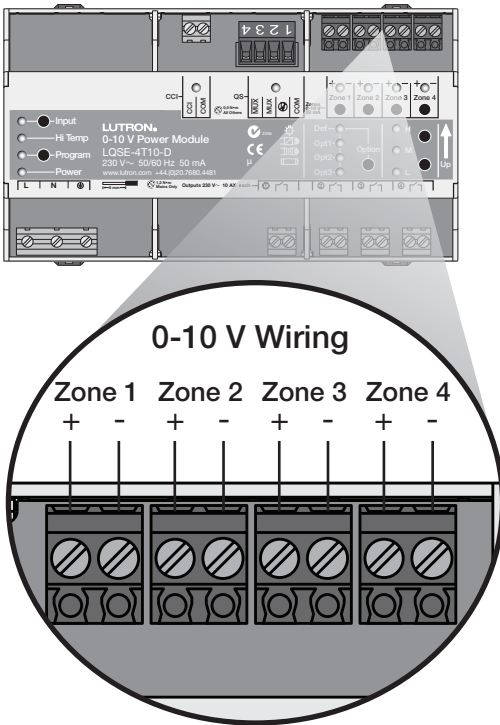

0-10 V Wiring (LQSE-4T10-D only)

- 0-10 V zones 1-4 are double-insulated from all other inputs and outputs.
- 0-10 V zones 1-4 are not insulated from each other. They share the same common (negative “-” terminal).
- Connect only SELV/IEC PELV circuits, or connect only non-SELV/IEC PELV circuits to 0-10 V zones 1-4. Do not mix SELV/IEC PELV circuits and non-SELV/IEC PELV circuits.
- Follow all national and local electrical codes for separation requirements.

Wiring: Manual Override Contact Closure Input

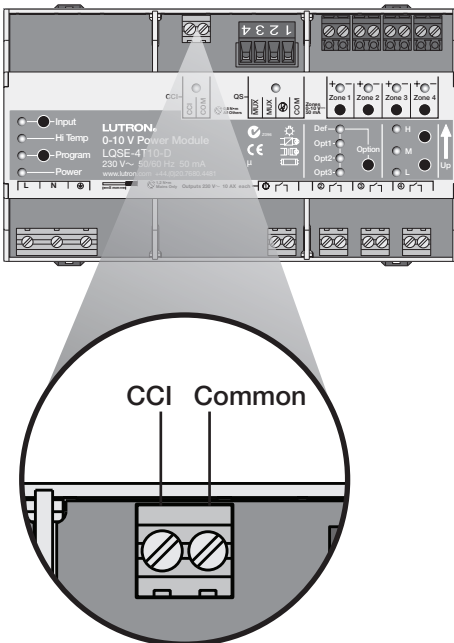



IEC PELV Manual Override Contact Closure Input

- Contact Closure Input (CCI) wiring is IEC PELV. Follow all applicable national and local codes for proper circuit separation and protection.
- When in Manual Override mode, all ballasts and modules will be at their programmed Manual Override light level (default is 100%). All other controls are locked out.
- Manual Override contact closure input is normally closed (NC). The Power Module unit is shipped with a jumper pre-installed.

Note: The Power Module unit will default to Manual Override Mode if the CCI is left open. If no Manual Override contact input is required, please leave the wire jumper in the CCI terminals.

Job Name:	Model Numbers:
Job Number:	

Wiring: QS Link

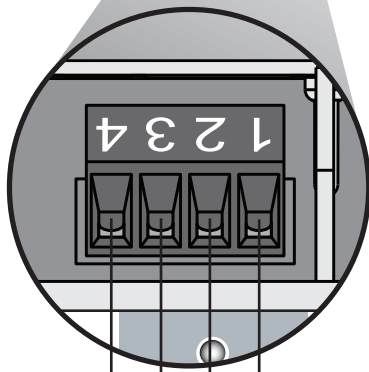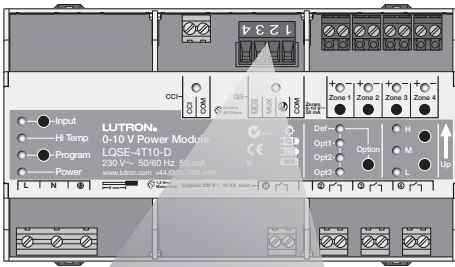

- (1) COM
- (2) (no connection)
- (3) MUX
- (4) MUX

IEC PELV QS Link Wiring

- Link communicates using IEC PELV wiring.
- Follow all applicable national and local codes for proper circuit separation and protection.
- Wiring may be daisy chained or t-tapped.
- Total length of QS link must not exceed 600 m.
- Wire Gauge:
 - Power (terminals 1 and 2): 1 pair 1,0 mm²
 - Data (terminals 3 and 4): 1 pair 0,5 mm² to 1,0 mm², twisted and shielded.
 - Can use Lutron cable GRX-CBL-346S-500
- Do NOT connect terminal 2.

Job Name:	Model Numbers:
Job Number:	